Q-PALL PLASTIC PALLETS

Technical specifications
Datasheet, edition October 2026

1100 x 1100 mm · CONTAINER PALLET

Plastic pallet 1100 x 1100 x 150 open deck 3 runners medium – 1.QP1111MB3R-AS

MEDIUM | Open deck | 3 runners

TOP



BOTTOM



7,500 kg	1,250 kg	250 kg
Static load on a flat floor	Dynamic load by forklift or pallet truck	Racking load in pallet racking

DIMENSIONS AND WEIGHT

Item number	1.QP1111MB3R-AS
Length	1100 mm
Width	1100 mm
Height	150 mm
Weight	11.7 kg

CONSTRUCTION AND MATERIAL

Top deck	Open deck
Bottom	3 runners
Load class	Medium
Nestable	No
Material	Nearly 100% recycled plastic (HDPE/PP)
Colour	Black (standard), other colours on request
ISPM 15	Exempt (no treatment needed)

DELIVERY AND DOCUMENTATION

PPWR (EU 2025/40)	Declaration of conformity available
Ordering in stacks	17 pallets per stack (stack dimensions approx. 1100 x 1100 x 2550 mm)

SIMILAR VERSIONS


ITEM NUMBER	DIMENSIONS (MM)	WEIGHT	STATIC	DYNAMIC	RACKING
1.QP1111MB3R-AS This datasheet	1100 x 1100 x 150	11.7 kg	7,500 kg	1,250 kg	250 kg
3.QP1111MB3R-AS	1100 x 1100 x 150	11.7 kg	7,500 kg	1,250 kg	250 kg
QP1111MB3R-SSB	1100 x 1100 x 150	12.3 kg	7,500 kg	1,250 kg	250 kg
2.QP1111MB3R-AS	1100 x 1100 x 150	11.7 kg	7,500 kg	1,250 kg	250 kg

Click an item number for the page and datasheet of that version. We deliver from a factory where your pallet is available, as close to you as possible. Small differences in height, weight and load capacity between the versions are possible.

1100 x 1100 mm · CONTAINER PALLET

Plastic pallet 1100 x 1100 x 150 open deck 3 runners medium – 1.QP1111MB3R-AS

TECHNICAL DRAWING

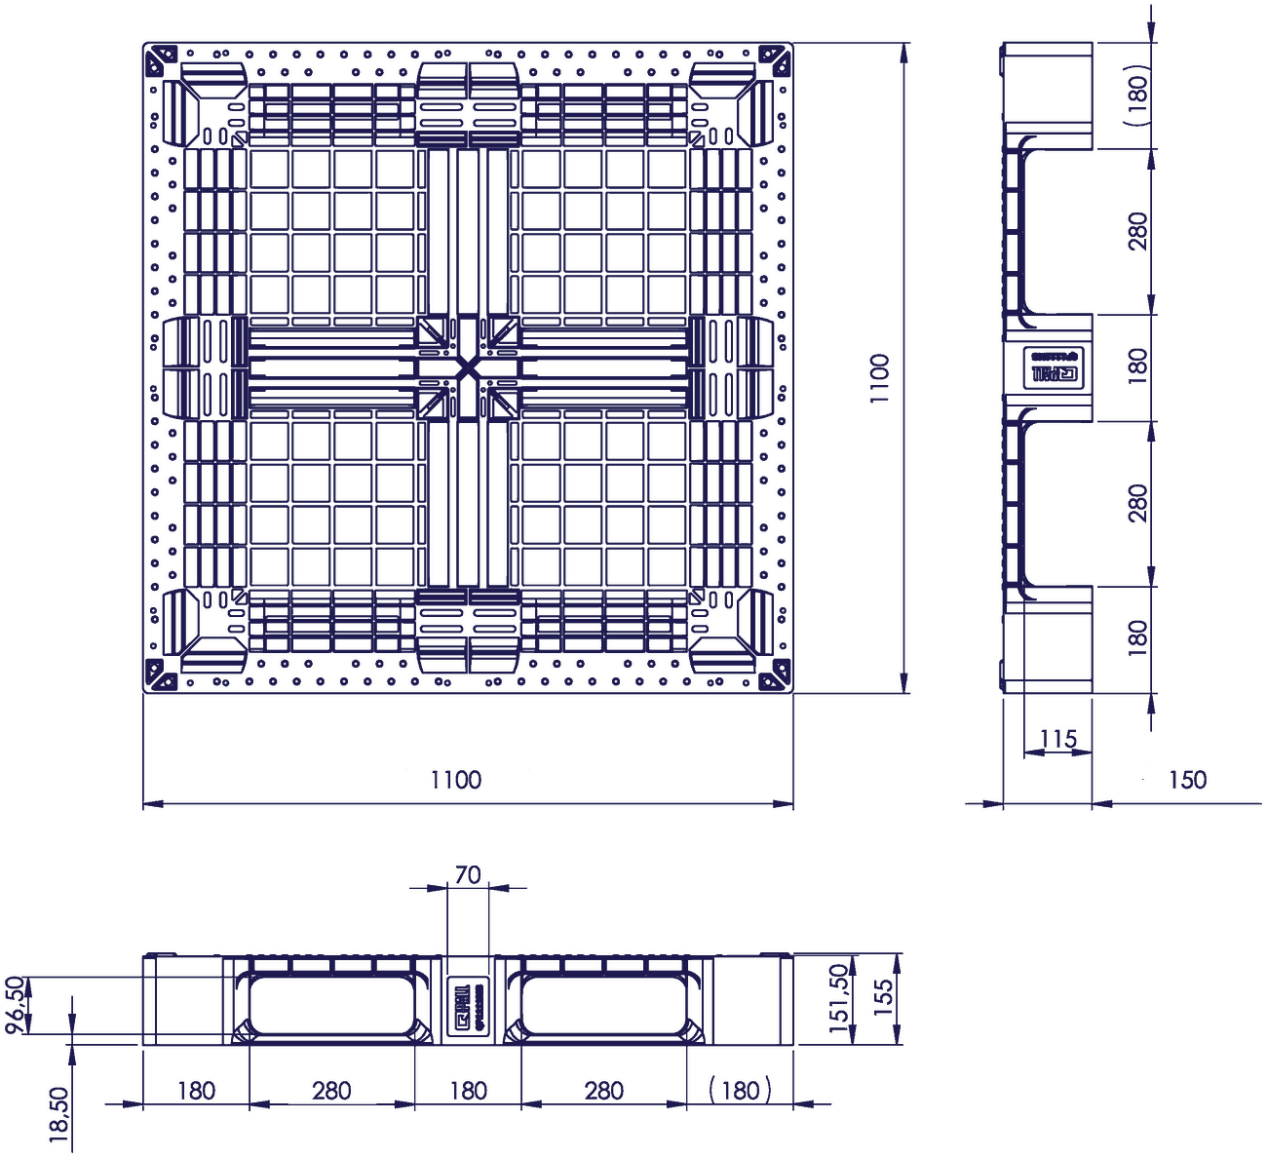

Top view and side views, dimensions in mm.

TEST CONDITIONS AND TOLERANCES

- The racking load is determined in a test with 25 kg bags on a conventional pallet racking system.
- Dimensional tolerance of the pallet: +5 / -5 mm. Weight tolerance: +5 / -5 %.
- We test our pallets with an evenly distributed, stable and homogeneous load of bagged goods, for a predetermined period at an ambient temperature of 20 °C. Different load conditions may lead to different results and must be assessed separately.